


SINGLE 2½" UNIT SET-UP

PURPOSE:

Accessing a static water source that can't be reached using standard hard sleeve suction hose compliment carried on a wildland fire unit.

EQUIPMENT NEEDED:

One 2½" TurboDraft Fire Eductor
2½" or 3" attack hose (Unit discharge)
1½" - 2" attack hose with 1½" NST fittings (Unit supply)
Pump rated at 175 psi flowing 60 gpm (minimum)

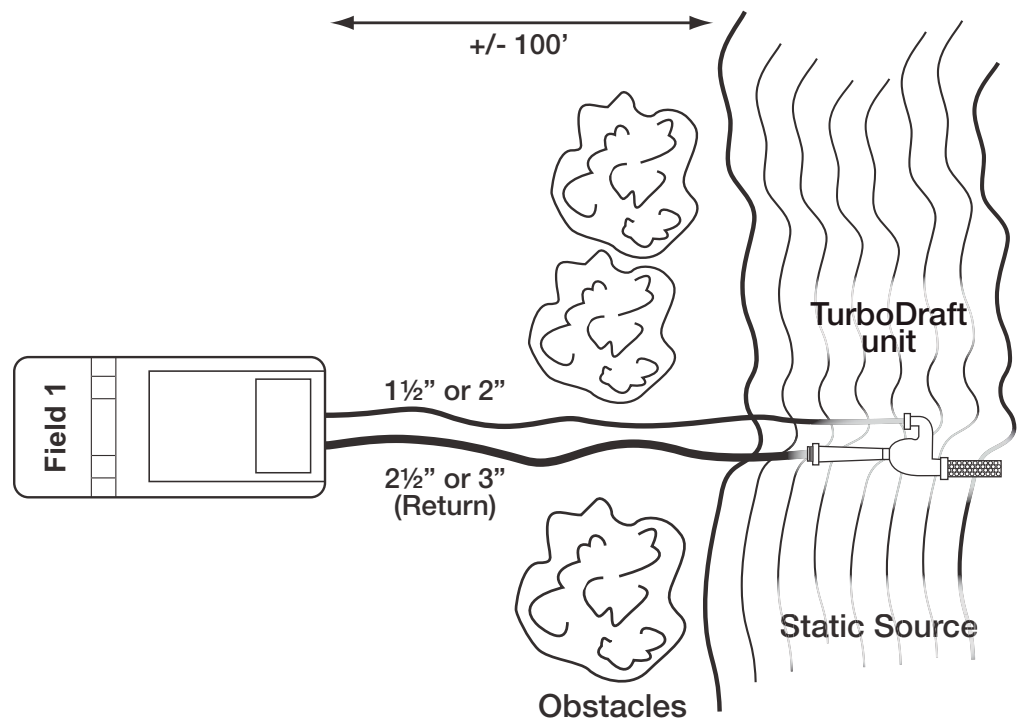

PROCEDURE:

Stretch hose lines from wildland fire unit to waters' edge
Make connections, deploy TurboDraft unit into static source
Charge unit as per operating manual
Maintain pressure on the TurboDraft