


#### SINGLE 2½" UNIT SET-UP

#### PURPOSE:

Accessing a static water source that can't be reached using standard hard sleeve suction hose compliment carried on a wildland fire unit.

#### EQUIPMENT NEEDED:

- One 2½" TurboDraft Fire Eductor
- 2½" or 3" attack hose (Unit discharge)
- 1½" - 2" attack hose with 1½" NST fittings (Unit supply)
- Pump rated at 175 psi flowing 60 gpm (minimum)

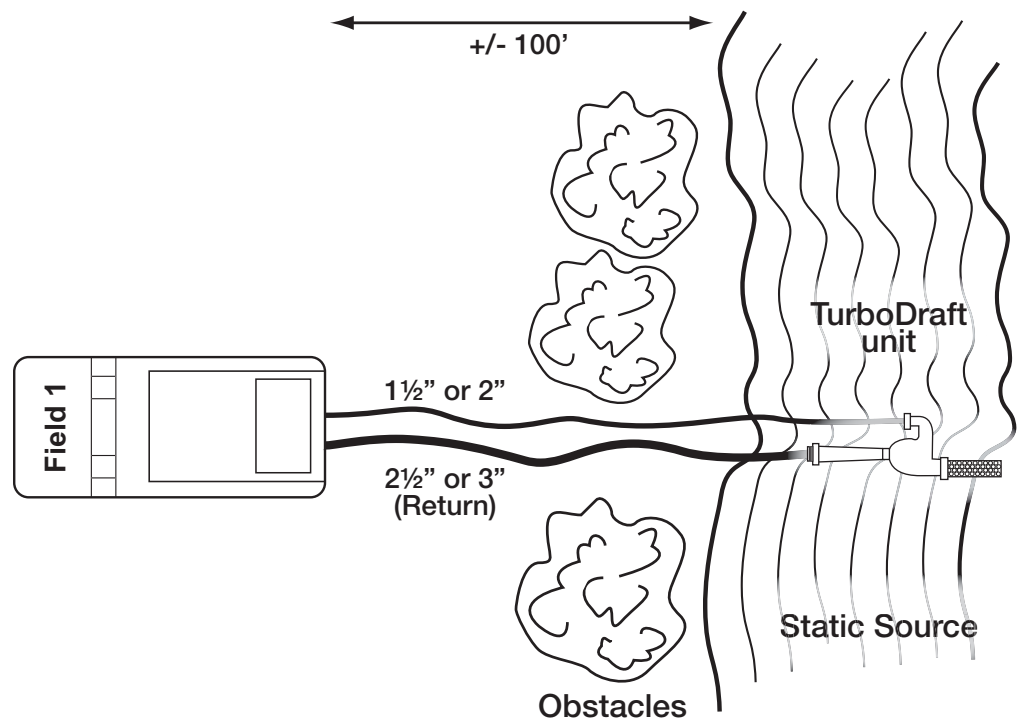

#### PROCEDURE:

- Stretch hose lines from wildland fire unit to waters' edge
- Make connections, deploy TurboDraft unit into static source
- Charge unit as per operating manual
- Maintain pressure on the TurboDraft