


## SINGLE 5" UNIT SET-UP

### PURPOSE:

Accessing a static water source that can't be reached using standard hard sleeve drafting hose compliment carried on the pumper-engine

### EQUIPMENT NEEDED:

- 1 5" TurboDraft Fire Eductor
- 5" LDH hose sections (25', 50', 100')
- 2½" or 3" attack hose
- 1000 gpm or larger pumper
- Gateable intake valve with air bleeder
- 300 gallon onboard water tank (minimum)
- Float buoy (optional)

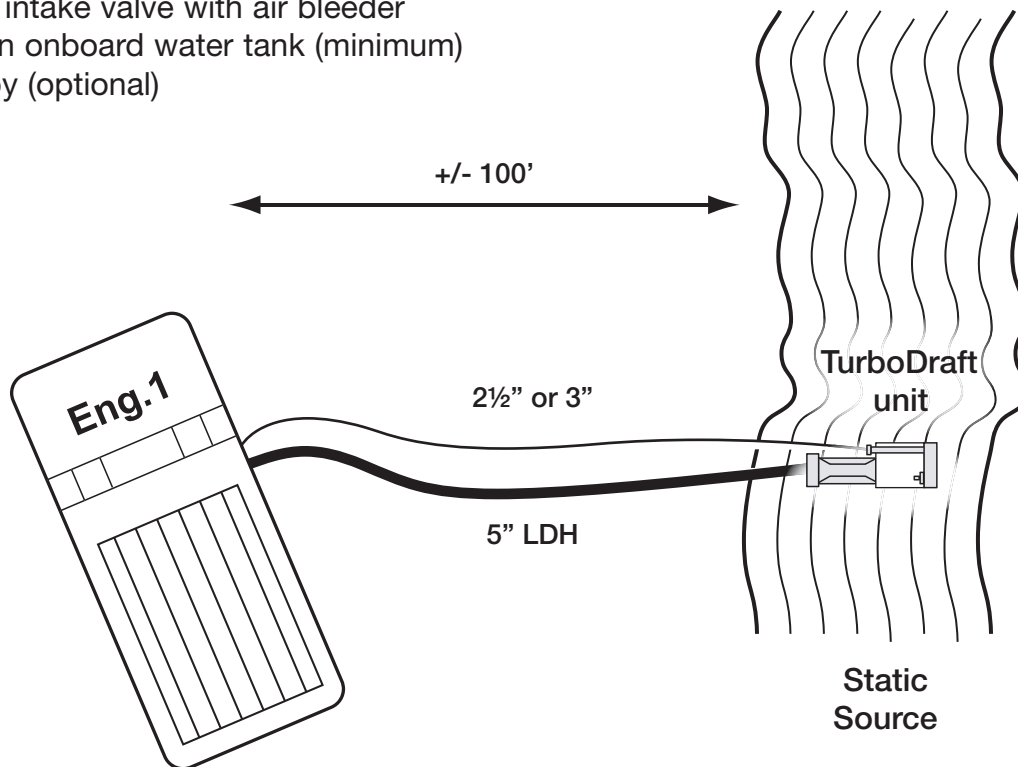

### PROCEDURE:

- Stretch hose lines from pumper to water edge
- Make connections
- Deploy TurboDraft unit into static source
- Charge unit as per operating manual