

## MULTIPLE 5" UNIT SET-UP


### **PURPOSE:**

Accessing a static water source that can't be reached using the standard hard sleeve suction hose compliment carried on the pumper.

This set-up provides double the flow rate of one TurboDraft Fire Eductor

### EQUIPMENT NEEDED:

- 2 5" TurboDraft Fire Eductors
- 5" LDH hose sections (25', 50', 100')
- 2½" or 3" attack hose
- 1000 gpm or larger pumper
- Gateable intake valve with air bleeder
- Secondary gateable intake with angled inlet
- 300 gallon onboard water tank (minimum)
- Float buoys (optional)

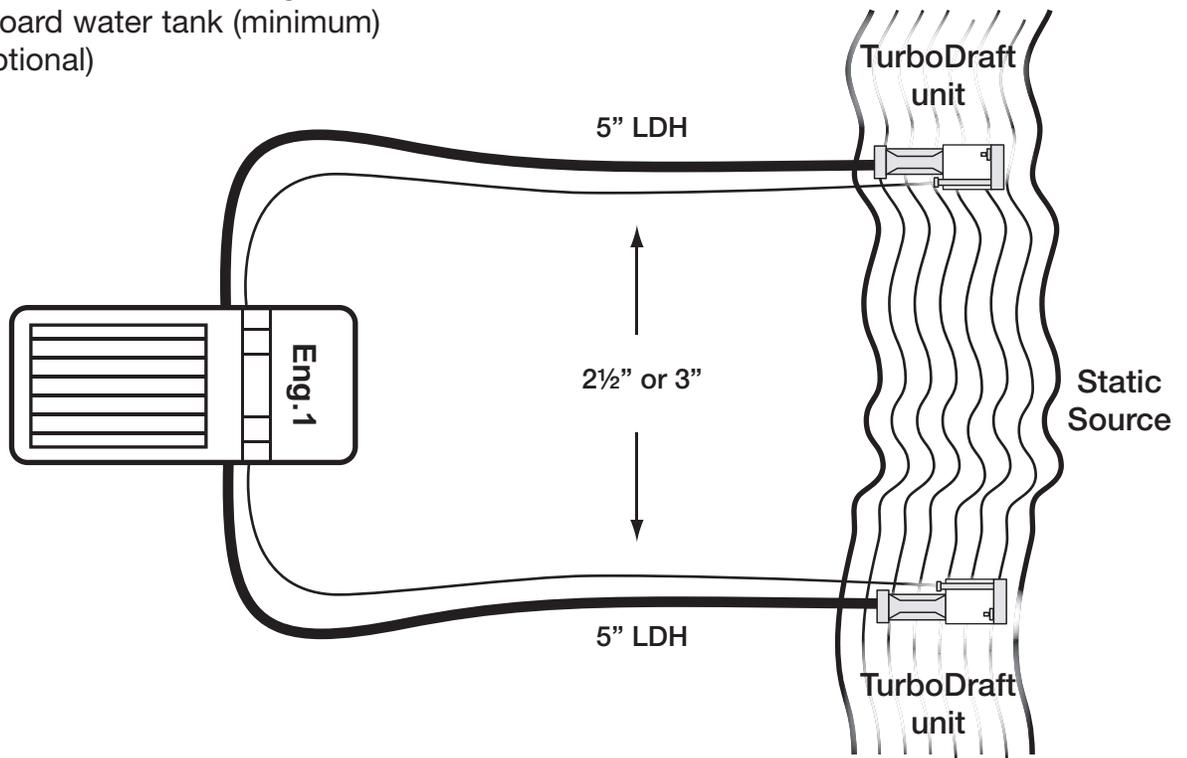

### PROCEDURE:

- Stretch hose lines from pumper to waters' edge
- Make connections
- Deploy first TurboDraft unit into static water source
- Charge unit as per operating manual
- Establish flow with first unit
- Repeat set-up for second unit